



PT1DN

Description

- Absolute Linear Position to 50 inches (1270 mm)
- Aluminum and Polycarbonate Enclosure
- Compact Design
- IP65 NEMA 4 Protection



The PT1DN communicates to your PLC over DeviceNET® and provides a precision position feedback signal for full-scale measurement ranges from 2 to 50 inches. Because the PT1DN uses a potentiometer as it's sensing element, the position signal is "absolute" and does not have to be reset to a "home" position upon startup.

 $C \in$

The PT1DN is part of our compact line of cable-extension transducers and is perfect where space is limited.

GENERAL


Full Stroke Ran	iges	0-2 to 0-50 inches	
Electrical Inter	face	CANbus ISO 11898	
Protocol		DeviceNET version 2.0	
Accuracy		\pm 0.25% to \pm 0.10% full stroke	
Repeatability		± 0.02% full stroke	
Resolution		± 0.003% full stroke	
Measuring Cable		.019-in. dia. nylon-coated stainless steel	
Enclosure	glass-filled polyc	arbonate and black anodized aluminum	
Sensor		plastic-hybrid precision potentiometer	
Potentiometer Cycle Life		see ordering information	
Maximum Retraction Acceleration		see ordering information	
Weight		1 lb. max.	


ELECTRICAL

Input Voltage	bus powered
Input Current	40 mA
Address Setting/Node ID	063 set via DIP switches (default setting: 63)
Baud Rate	125K, 250K or 500K set via DIP switches
EDS File	available @ http://www.celeso.com/download

ENVIRONMENTAL

Environmental Suitability	NEMA 4, IP 67
Operating Temperature	0° to 185°F (-17° to 85°C)
Vibration	up to 10 g to 2000 Hz maximum





Output signal





I/O Format:

Data Frame Data Frame

Data Field



 B_0 = LSB current measurement byte B_1 = MSB current measurement byte

B₂ = LSB full stroke range byte B₃ = MSB full stroke range byte

 $B_4 - B_7 = not used$

*Current Measurement Count

The Current Measurement Count (CMC) is the output data that indicates the present position of the measuring cable.

The CMC is a 16-bit value that occupies the first two bytes (B_0 and B_1) of the data field. B_0 is the LSB (least significant byte) and B_1 is the MSB (most significant byte).

The CMC starts at 0000H with the measuring cable fully retracted and continues upward to the end of the stroke range stopping at FFFFH. This holds true for all ranges.

**Full Stroke Range

The Full Stroke Range (FSR) is a 16-bit value in the data field that expresses the full range of the sensor in inches. This value can be used to convert the actual count to units of measurement should the application require it.

The full stroke measurement range occupies the second two bytes (B_2 and B_3) of the data field.

 B_2 is the LSB (least significant byte) and B_3 is the MSB (most significant byte).

This value is expressed in inches.

Example:

Hex Value	Decimal Equivalent	Full Stroke Range
001E	30	30 inches

Converting CMC to Inches

If required, the CMC can easily be converted to a linear measurement expressed in inches instead of just counts.

This is accomplished by first dividing the CMC by 65,535 (total counts over the range) and then multiplying that value by the FSR:

$$\left(\begin{array}{c} \text{CMC} \\ \hline 65.535 \end{array}\right)$$
X FSR

Example:

If the full stroke range is 30 inches and the current position is 0FF2 Hex (4082 Decimal) then,

$$\left(\frac{4082}{65,535}\right)$$
 X 30.00 inches = 1.87 inches

Address Setting (Node ID), Baud Rate and Bus Termination Settings

Address Setting (Node ID)

The Address Setting (Node ID) is set via 6 switches located on the 8-pole DIP switch found on the DeviceNET controller board located inside the transducer.

The DIP switch settings are binary starting with switch number 1 (= 2^0) and ending with switch number 6 (= 2^5).

DIP-1 (2 ⁰)	DIP-2 (2 ¹)	DIP-3 (2 ²)	DIP-4 (2 ³)	DIP-5 (2 ⁴)	DIP-6 (2 ⁵)	address (decimal)
0	0	0	0	0	0	0
1	0	0	0	0	0	1
0	1	0	0	0	0	2
1	1	1	1	1	1	63
= "0" = "1"						

Baud Rate

The transmission baud rate may be either factory preset at the time of order or set manually at the time of installation.

The baud rate can be set using switches 7 & 8 on the 8-pole DIP switch found on the DeviceNET controller board located inside the transducer.

DIP-7	DIP-8	baud rate
0	0	125k
1	0	250k
0	1	500k
1	1	125k




Bus Termination

The setting of the internal bus termination resistor may be specified upon order or manually changed by the end user at the time of installation.


The bus termination resistor is activated setting switches 1 & 2 on the 2-pole DIP switch (located on the internal DeviceNET controller board) to the "ON" position.



DeviceNET Controller Board and DIP Switch Location




to gain access to the controller board, remove four Allen-Head Screws and remove rear cover.

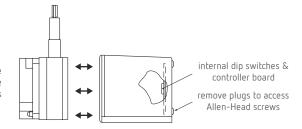





Outline Drawing



Range	А
2, 10	1.04 [26,4]
5, 25, 50	0.58 [14,7]
15, 30	0.82 [20,8]
20, 40	0.74 [18,8]
	inches [mm]

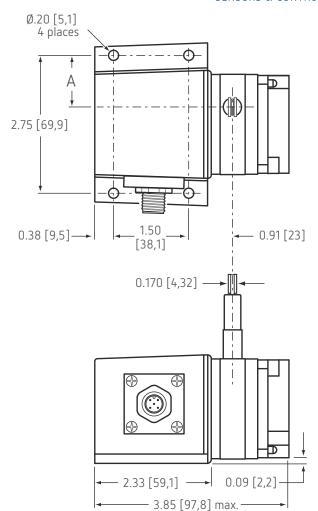

* tolerance = +.005 -.001[+.13 -.03]** tolerance = +.005 -.005[+.13 -.13]

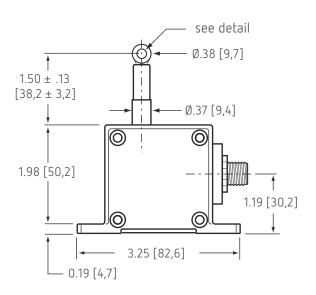

DIMENSIONS ARE IN INCHES [MM]

tolerances are 0.03 IN. [0.5 MM] unless otherwise noted.

Outline Drawing

Model Number:



Sample Model Number:

PT1DN - 30 - UP - SG - 500 - TR - SC5

R range:A measuring cable exit: 30 inches

B cable guide:

spring-loaded guide baud 500 k bits/sec. terminating rate:
resistor:

yes 5 meter cordset with straight plug electrical connection:


Full Stroke Range:

R order code:	2	5	10	15	20	25	30	40	50
full stroke range, min:	2 in.	5 in.	10 in.	15 in.	20 in.	25 in.	30 in.	40 in.	50 in.
accuracy (% of f.s.):	0.2	5%		0.1	5%			0.10%	
potentiometer cycle life:	2,500,00	00		500,00	00 cycles		2	50,000 cycle:	S
cable tension (20%):	12 oz.	5 oz.	12 oz.	9 oz.	6 oz.	5 oz.	9 oz.	6 oz.	5 oz.
max. cable acceleration:	11 g	3 g	11 g	5 g	4 g	3 g	5 g	4 g	3 g




Ordering Information (cont.)

Cable Exit:

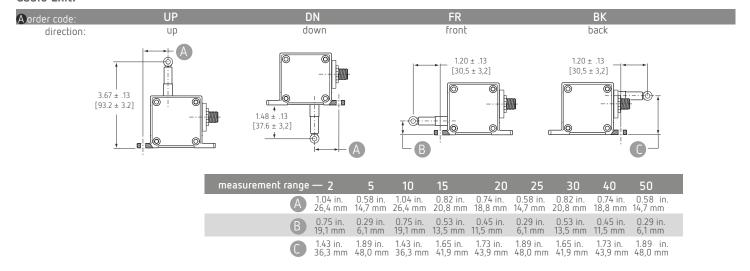

Cable Guide:

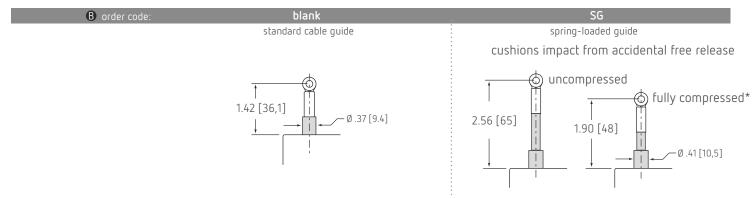

^{*}note: start of full stroke range begins at full compression point (except 2-inch and 5-inch ranges).

Baud Rate:

C Ordercode:	125	250	500
	125 khaud	250 khaud	500 khaud


Terminating Resistor:

•		
O order code:	TR	NR
	terminating register	no terminating resistor



Ordering Information (cont.)

Electrical Connection:

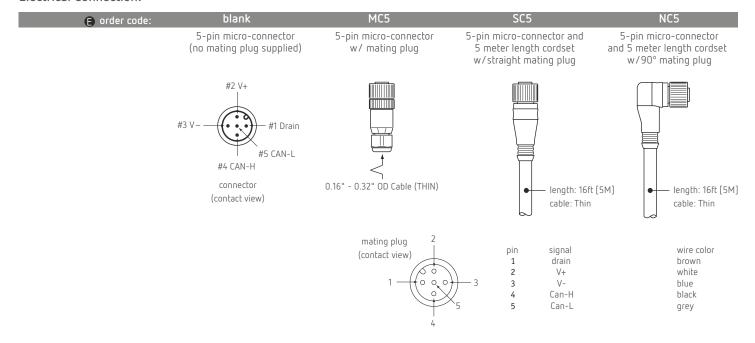

12.2015 | version 20140313 Re